S. G. H. 27—104.0'6—4-11-49.

(195 .) Department.

SERIES.

G.O. NO. 1705

Dated 26.4.51

[Despatch Abstract.]

ELECTRICITY - Indian Electricity Rules 1937 - Mangalore Electric Licence - Rule 60(1)(d) - Relaxed.

:::

F. 33c—1000.

THE MANGALORE ELECTRIC SUPPLY COMPANY, LIMITED.

MANAGING AGENTS:
Octavius Steel & Co., Ltd.,
CALCUTTA.

8615

Resident Engineer's Office,
Mangalore, 19th March 1951.

Ref. No. MAN/ 674/5A

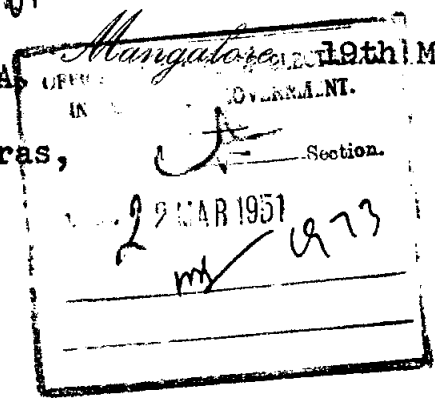

To
The Secretary to the Govt. of Madras,
Public Works Department,
Fort St. George,
Madras.

Through
The Chief Electrical Inspector,
157, Mount Road,
Madras.

Dear Sir, Provision of linked Switches between the Terminals of 267 K.W. Alternator Sets - Rule 60(i)(d) of the Indian Electricity Rules 1937

With reference to G.O. Ms. No. 36267 dated 31.8.1950, I have to inform you that the two sets of linked switches were duly received and were immediately installed between the terminals of the two numbers 267 K.W. Alternators and the L.T. side of the step-up Transformers inside the step-up substation at Power House on 11.3.1951.

It is requested that ~~per~~ the Government may be pleased to extend the period of relaxation further from 1.1.1951 to 11.3.1951.

Yours faithfully,
A.A. Shetty
19/3/51
For Resident Engineer.

M.A. Gopalakrishna
19/3/51

OFFICE OF THE CHIEF ELECTRICAL INSPECTOR
TO GOVERNMENT, 157, Mount Road, Madras 2.

Endorsement No. 1975 E.1/51-1 dated 13-4-51.

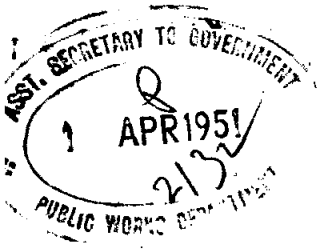

Sub:-Electricity- Mangalore Electric Supply Co.,Ltd., Rules 60(1)(d) of Indian Electricity Rules-relaxation of.
Ref:- Letter No.Man/674/5A dated 19-3-51 from Messrs.Mangalore Electric Supply Co.,Ltd.,

---

Forwarded to the Secretary to Government, Public Works Department, Madras.

2. The provisions of rule 60(1)(d) of Indian Electricity Rules were relaxed upto 31-12-50 in regard to the provision of linked switches between the terminals of the two Nos.267 K.V. alternators and the Low Tension side of the step-up transformers in the step up sub station of Messrs. Mangalore Electric Supply Co., Ltd., in G.O.Ms. No. 3267 P.W.D. dated 31-8-50. The licensee reports that linked switches have been installed between the terminals of the two alternators and the L.T.side of the step up transformers on 11-3-51 and requests that the period of relaxation upto 31-3-51.

3. Under the circumstances, I recommend that the period of relaxation may be extended upto 11-3-52.

for C.E.I.

The Secretary to Govt. Public Works Department,
Fort St.George, Madras.

5 PW(P)

2nd Cl

16/M Ebey — Indian Electricity Rules 1937 — Mangalore Electric Licence — Rule 60 (1) (d) - Relaxed.

P5 (I) 77 26.4 P1 6

Ref: Read again: Gr o no 3267 PW dt 31.8.50

" From the Mangalore Electric Supply Company Ltd 674/5 A= dt 19.3.51.

P3 6

" CE & Gr endt no 1973 E.1/51-1 dt 13.4.51.

Grms no 1705 dt 26.4.51

P 11 7 ... book

In exercise of the powers conferred by rule 117 (1) of the Indian Electricity Rules 1937 H.E. the Governor of Madras hereby directs that the provisions of rule 60 (1) (d) of the said rules be relaxed in regard to the provision of linked switches between the terminals of the two numbers 267 KW alternators and the H.T. side of the step up transformers in the step up Sub-station of the Mangalore Electric Supply Co. Ltd for a further period up to and inclusive of 11th March 1951.

To the Mangalore Electric Supply Co. Ltd Mangalore

Copy to the CE & Gr I & C.

RR 24.4.51.

27/4

MM 24/4

MM 24/4/51

THE MANGALORE ELECTRIC SUPPLY COMPANY, LIMITED.

MANAGING AGENTS:
Octavius Steel & Co., Ltd.,
CALCUTTA.

Resident Engineer's Office,

Mangalore, ... 8th May 19 51

Ref. No. MAN/ 1092/5A

The Secretary to the Govt.of Madras,
P.W.D.,
Fort St.George,
Madras.

Dear Sir, Provision of Linked Switches between the Terminals of 267 K.W.Alternator Sets - Rule 60 (i)(d) of the Indian Electricity Rules 1937

Your proceedings G.O.Ms.No. 1705 dated 26.4.1951 is hereby acknowledged with thanks.

Yours faithfully,

A.V.Shetty
8/5/51
For Resident Engineer.

8/5/51

P W (P)
May be filed with the Go at (G)
25.5.51.
16/5/51